

2021

Installation and Debugging of Intelligent Building System

DDC

4

30%

30%

7%

NVR

10%

DDC

DDC

DDC

12%

8%




3%

2

1-2

,

4

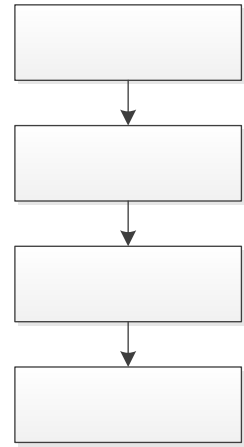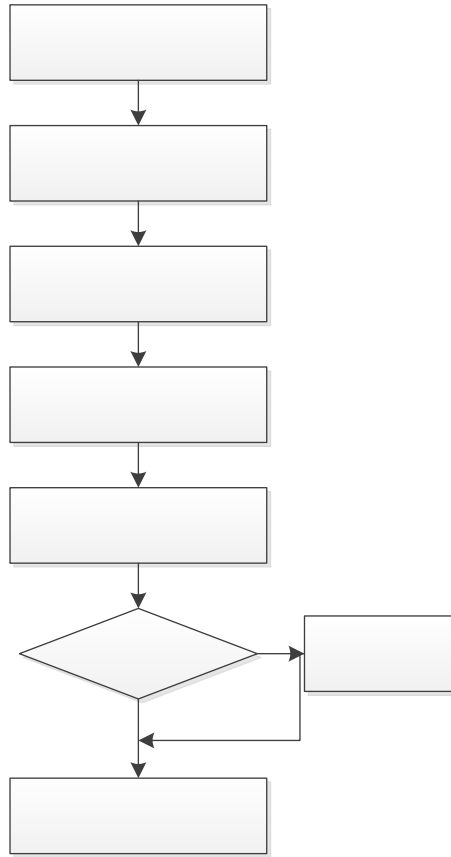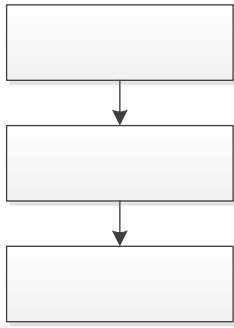

1.

2.

21

3.

2

1-2

1.

2.

2

30

1.

2.

3.

4

4.

5.

3

1-5

6.

7.

	16m <sup>2</sup>	4.5m×3.6m
1	1	1
	1.0m	1.5m

1. GB50303-2015
2. GB50314-2015
3. GB50339-2013
4. GB50348-2018
5. GB50394-2007
6. GB50395-2007
7. GB50396-2007
8. GA308-2001

2018

THBCAS-2B



1. AC220V  $\pm$  10% 50Hz
2. -10 40 85% 25 4000m
3. 1kVA
4. 3120mm  $\times$  1580mm  $\times$  2310mm
- 5.

1.

2.

3.

DDC

4.

5.

NVR

19

6.

7.

8.

1		3120mm × 1580mm × 2310mm	1	
2		600mm × 600mm × 800mm	1	
3		300mm × 450mm	1	
4		900mm × 250mm × 1200mm	1	
5	DDC	600mm × 450mm × 150mm	1	
6		20mm × 10mm × 11mm	300	



9.

1			1
2		NVR	1
3		PM2.5	CO <sub>2</sub> 1
4		DDC	1

10.

1		U 2B	1
2		U PVC	1

	30%	1.	15%		5mm

				DDC	
				5mm	
				5mm	
		2.	15%	DDC	

2.

1

2

3

4

3.

4 6 1

10 15 1

4.

5.

1

10 20

2

5 10

3

5 10

6.

7.

8.

9.

30%

15%

5%

10.

2



/

1.

2.

3.

1.

2.

3.